

06 March 2026

Addendum 4

Beaufort EMS


Beaufort, NC

The following addendum shall supersede previous information and does hereby become part of the contract documents.


- Clarification; Spec Section 09660: LVP flooring to be 5"x48" planks.
- Overhead Doors to be model # 426 by Overhead Door Corporation, Insulated Steel Doors (white) with side mount operators. Provide 4 port hole view panels. Interior door panels to be steel. Design pressure to be 69 psf. Provide (2) push button controls per door and (1) remote per door. Provide photo electric sensors. Equal products will be acceptable.
- See SK-1 for generator location.
- Provide a \$25,000.00 allowance for testing.
- Laundry Room 118 clarification: A counter is not required at this time.
- Clarification, 1/A-5.2: Fire rated ceilings to be constructed per detail 1/G-3.1 suspended from trusses.
- Clarification: Concrete design strengths shall be as per the structural drawings. Attention is called to detail 1C/S5.1 for slab reinforcing.
- Equal products by EFCO or Old Castle will be acceptable.
- Clarification: Retainage for this project is 5%.
- Clarification: Builders Risk is to be part of this Contract.

End of Addendum 4

**BEAUFORT EMS
STEEL TANK ROAD SUBSTATION**
BEAUFORT, NORTH CAROLINA

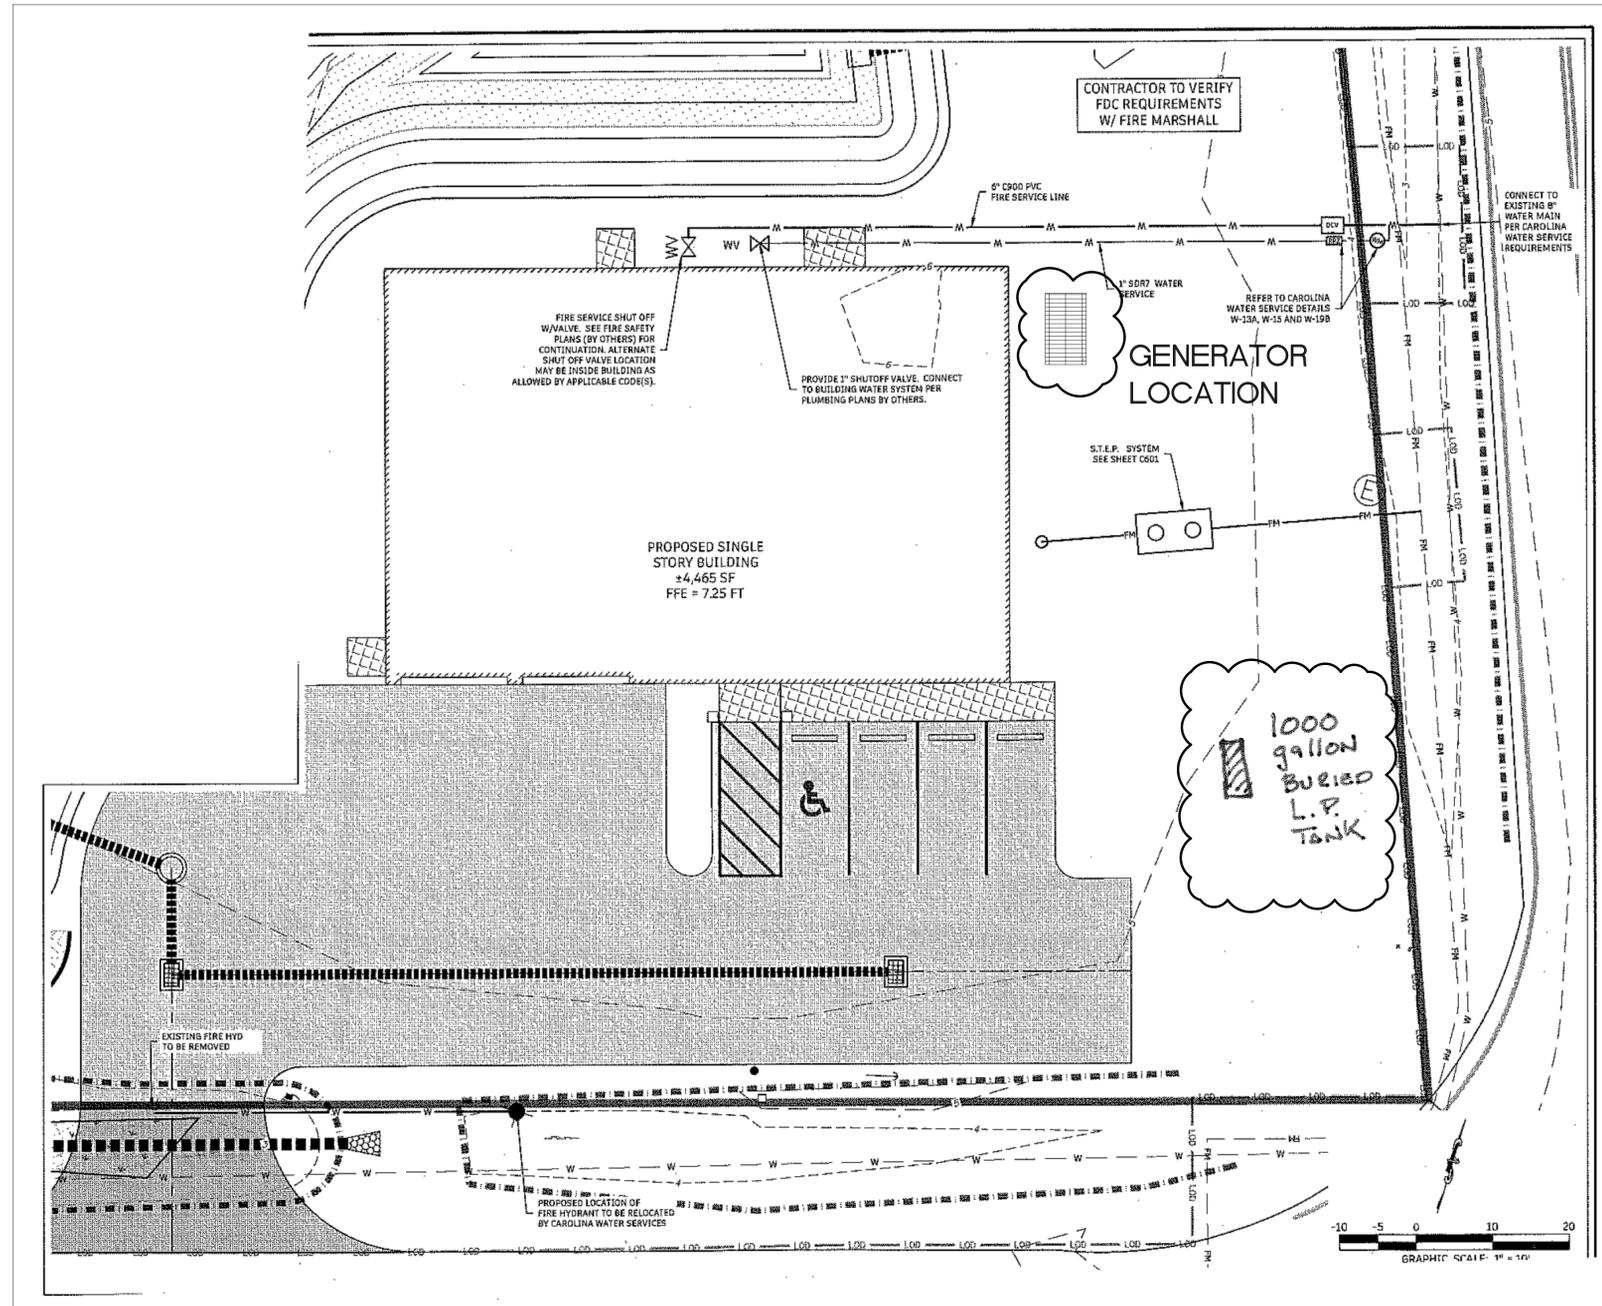

L.P. TANK LOCATION
SCALE: N.T.S.



L.P. TANK LOCATION

25003

ISSUED: 02/25/26

DWG BY: MSG

CKD BY: LDD

REVISIONS

SHEET NO.

SK-1

OF